


TWO STAGE ALARM EQUIPMENT FOR WASTE OIL

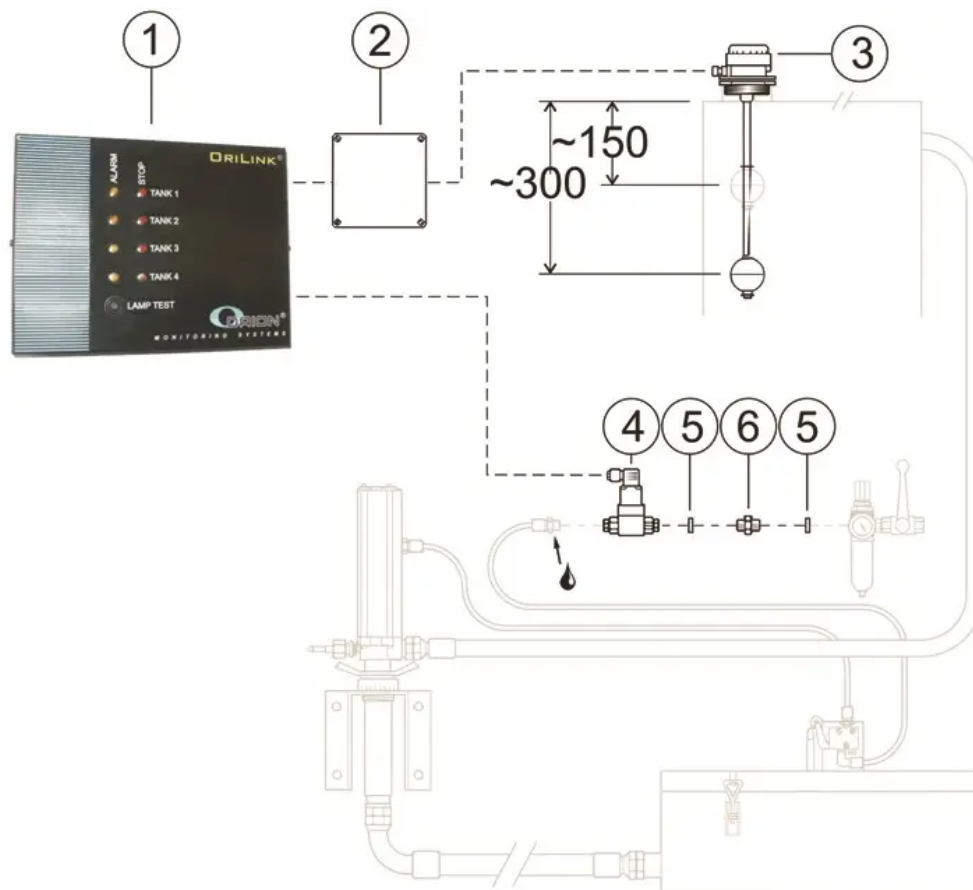

Part No
SPEC8042

TECHNICAL DATA

TWO STAGE ALARM EQUIPMENT FOR WASTE OIL

The equipment is EX-classified in accordance with waste oil handling regulations. The box can handle 6 different solenoid valves (24 V DC).1 Control panel 234302 Ex ia Barrier 231873 Level switch 231324 Solenoid valve 48059

TECHNICAL DATA

Part No	SPEC8042
H.S. Code	85371010