


USED FLUID SENSOR 23132/53132 (2-LEVEL) WITH 23417/53417 AND AIR SOLENOID WHEN USING 2 SENSORS ON SAME PORT

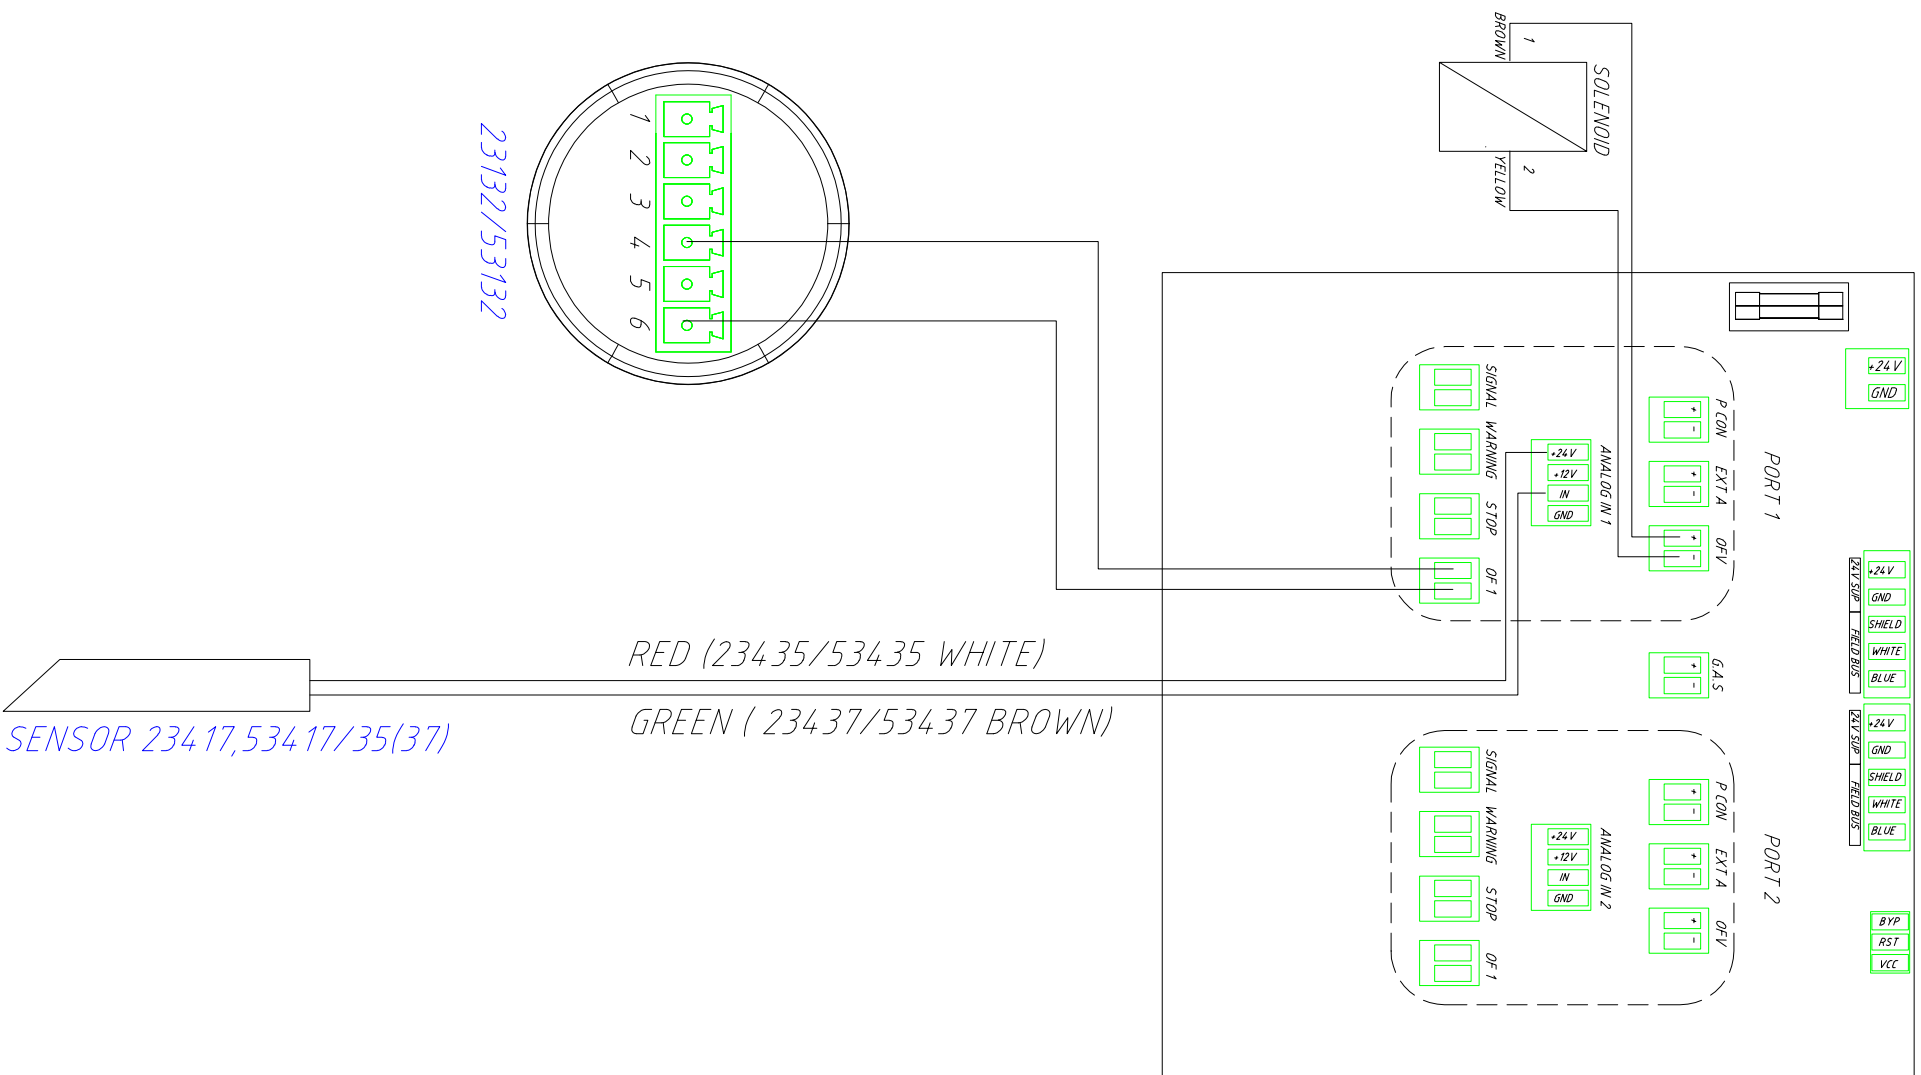

RED (23435/53435 WHITE)

GREEN (23437/53437 BROWN)

SENSOR 23417,53417/35(37)

23132/53132



Alentec & Orion AB
Grustagsvägen 4
SE-138 40 Alfta

FLUID MANAGEMENT SYSTEM

RESPONSIBLE

MIKAEL COMSTEDT

DRAWN BY

MICO

SCALE

1:XXX

FILE NAME

ELECTRIC INSTALLATION UTANK DWG

Tel: +46 (0)8 747 67 00
Fax: +46 (0)8 715 20 74
E-mail: info@alentecc.se
www.alentec.com

DATE OF ORG

211004

CHECKED BY

KRTY

DATE

250507

PROJECT NO

REV

4