USED FLUID. SENSOR 23132/53132 (2-LEVEL) WITH
23187/53187 AND 23417/53417 AIR SOLENOID
WHEN USING 2 SENSORS.

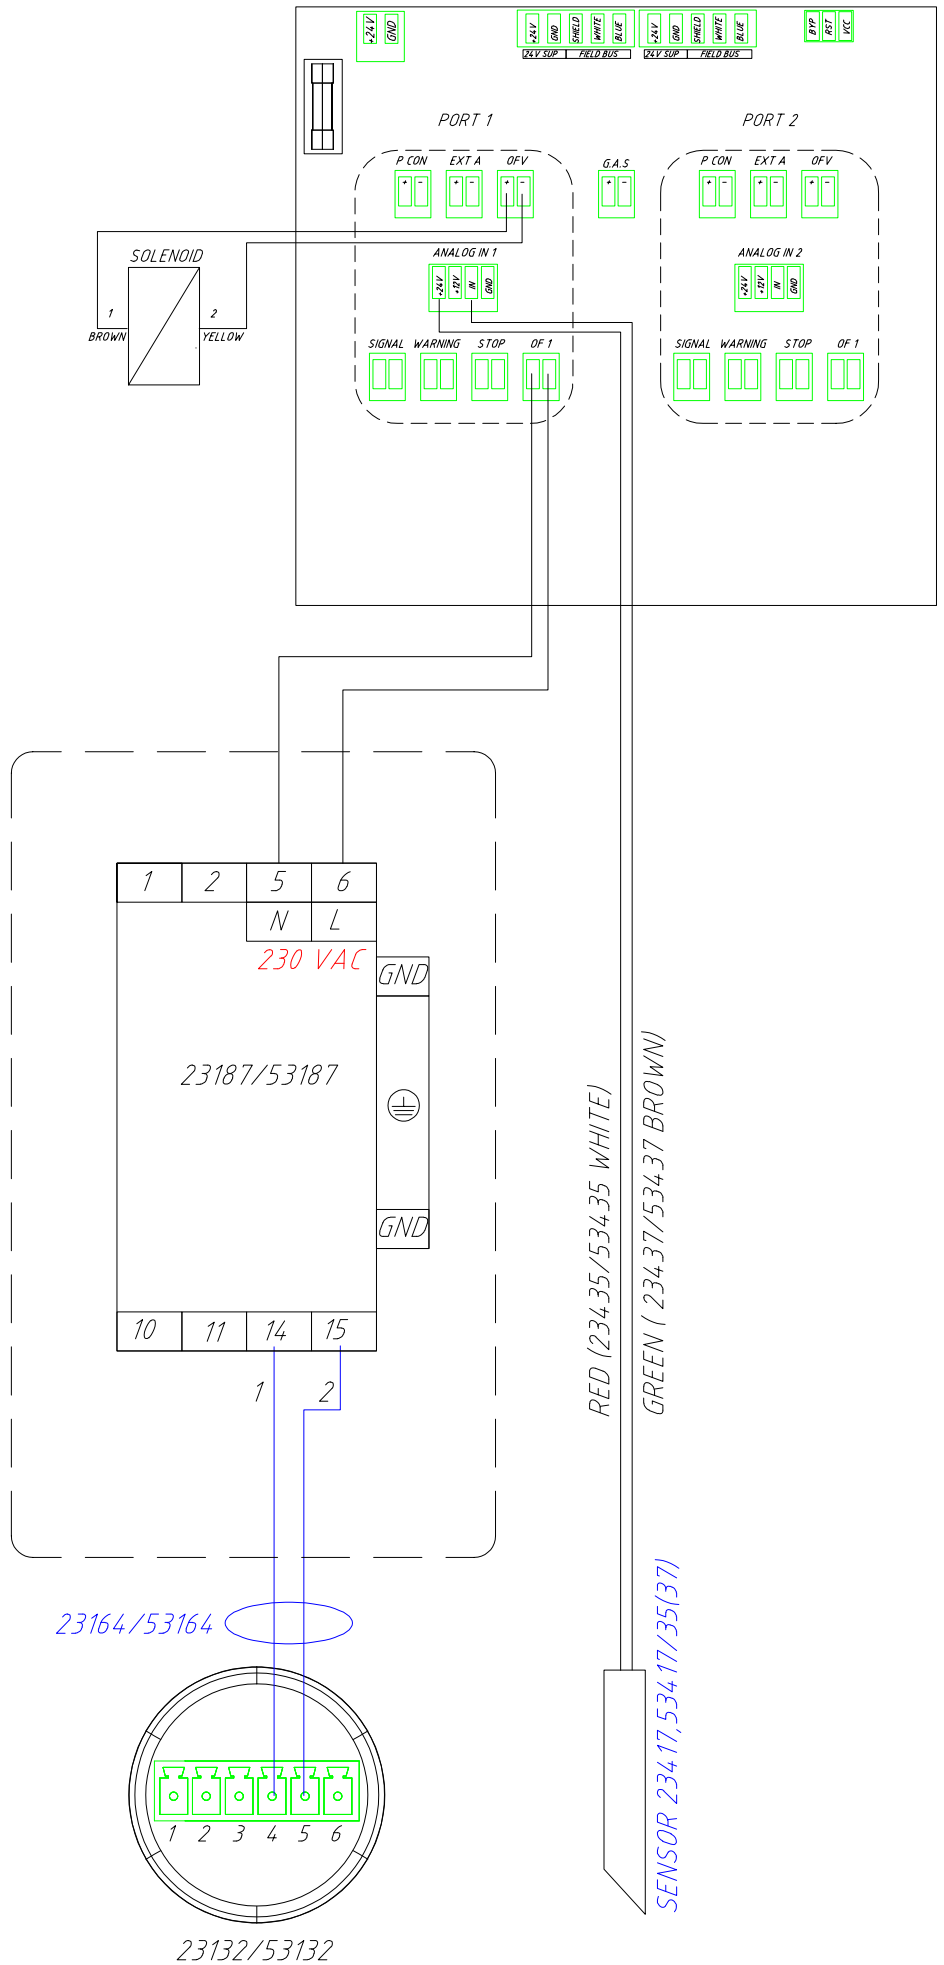

This drawing remains the property of Alentec & Orion AB
and is not to be copied without our permision
nor is it to be shown or handed over to
comprehensive firms or any third person

NEXU FLUID MANAGEMENT SYSTEM

Alentec & Orion AB
Grustagsvägen 4
SE-138 40 Älta

Tel: +46 (0)8 747 67 00
Fax: +46 (0)8 715 20 74
E-mail: info@alentec.se
www.alentec.com

RESPONSABLE: MIKAEL COMSTEDT				
DRAWN BY: MICO	DATE OF ORG: 241004	CHECKED BY: KRTY	DATE: 241023	PROJECT NO:
SCALE: 1XXX	TYPE: SENSOR 23132/53132,23187/53187,23417/53417			
FILE NAME: ELECTRIC INSTALLATION UTANK.DWG				REV.: A