USED FLUID SENSOR 23132/53132 (2-LEVEL) WITH 23187/53187
AND 23417/53417 WITH 23188/53188 AND AIR SOLENOID
WHEN USING 2 SENSORS WITH EX RELAYS

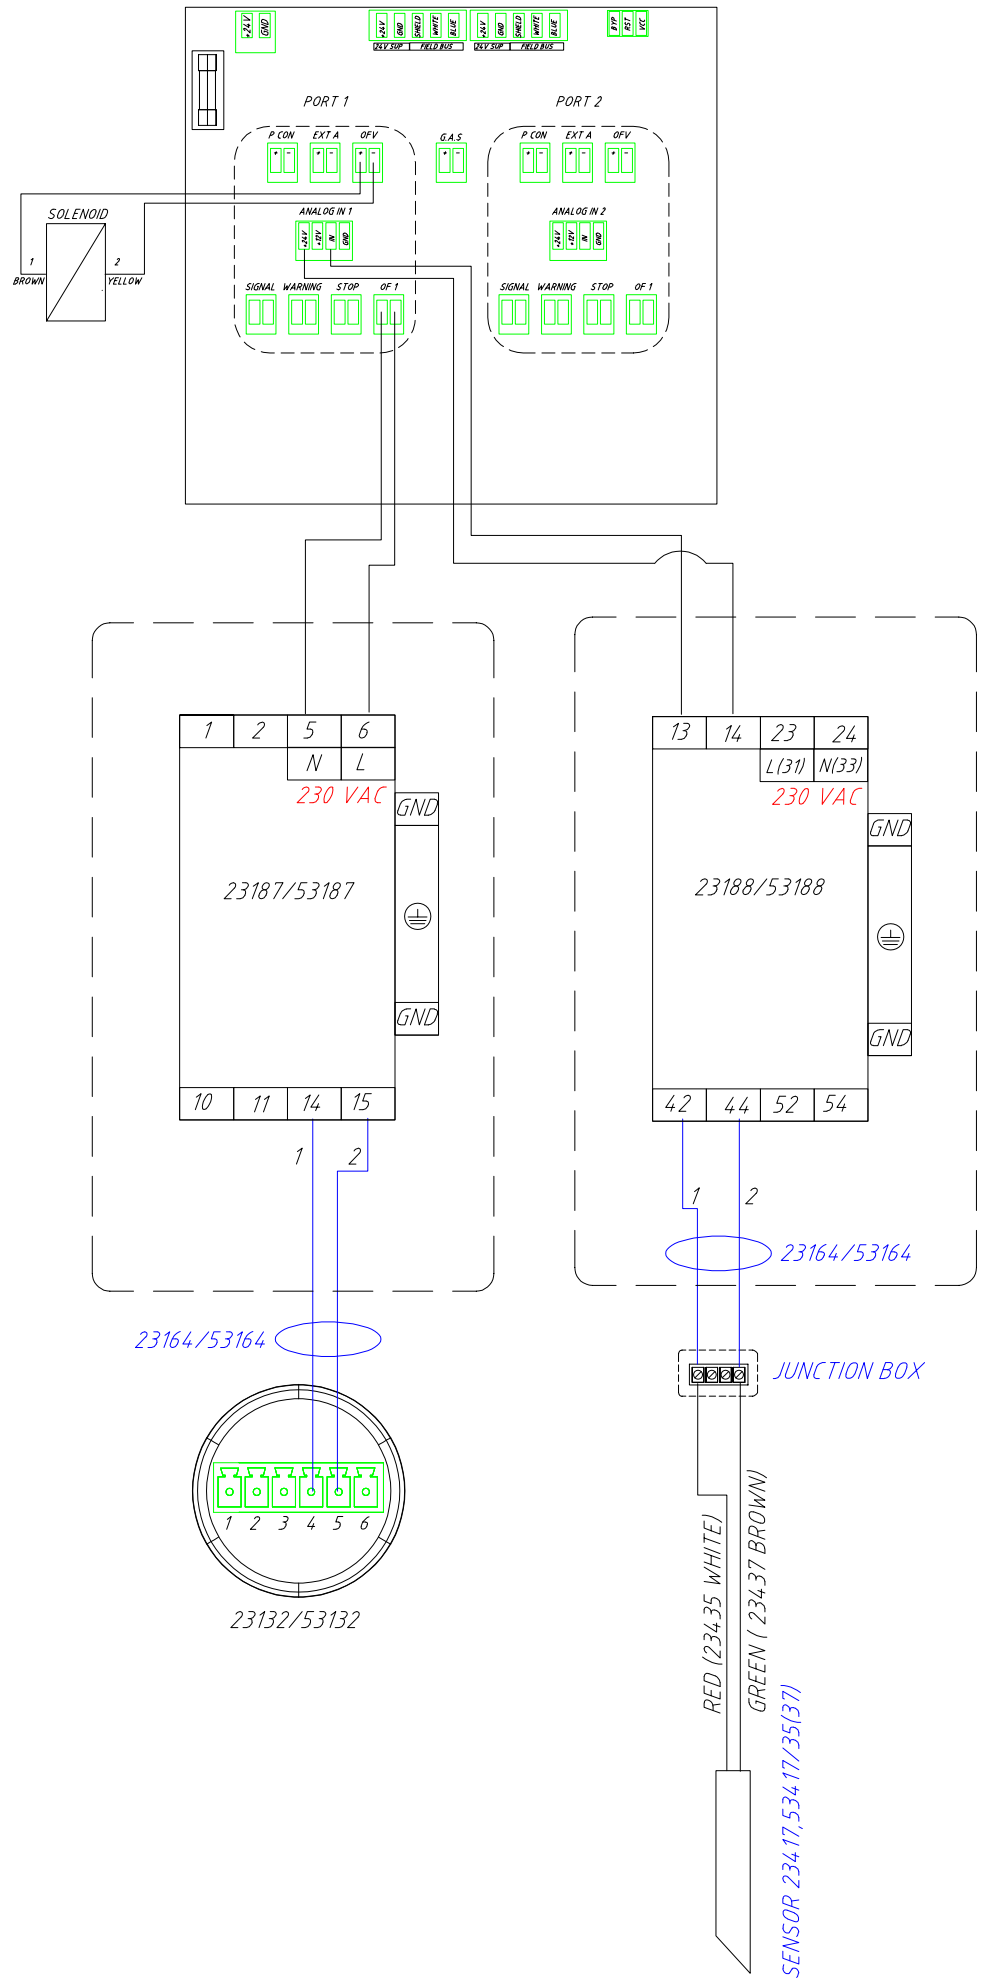

NEXU FLUID MANAGEMENT SYSTEM

Alentec & Orion AB
Grustagsvägen 4
SE-138 40 Alta

Tel: +46 (0)8 747 67 00
Fax: +46 (0)8 715 20 74
E-mail: info@alentec.se
www.alentec.com

RESPONSABLE				
MIKAEL COMSTEDT				
DRAWN BY	DATE OF ORG	CHECKED BY	DATE	PROJECT NO
MICO	241004	KRTY	241023	
SCALE	TYPE			
1XXX	SENSOR 23132/53132,23187/53187,23417/53417			
FILE NAME				REV.
ELECTRIC INSTALLATION UTANK.DWG				A

This drawing remains the property of Alentec & Orion AB
and is not to be copied without our permision
nor is it to be shown or handed over to
comprehensive firms or any third person