


FRESH FLUID. SENSOR 23171/53171, 2330287/53287
(1-LEVEL) AND AIR SOLENOID

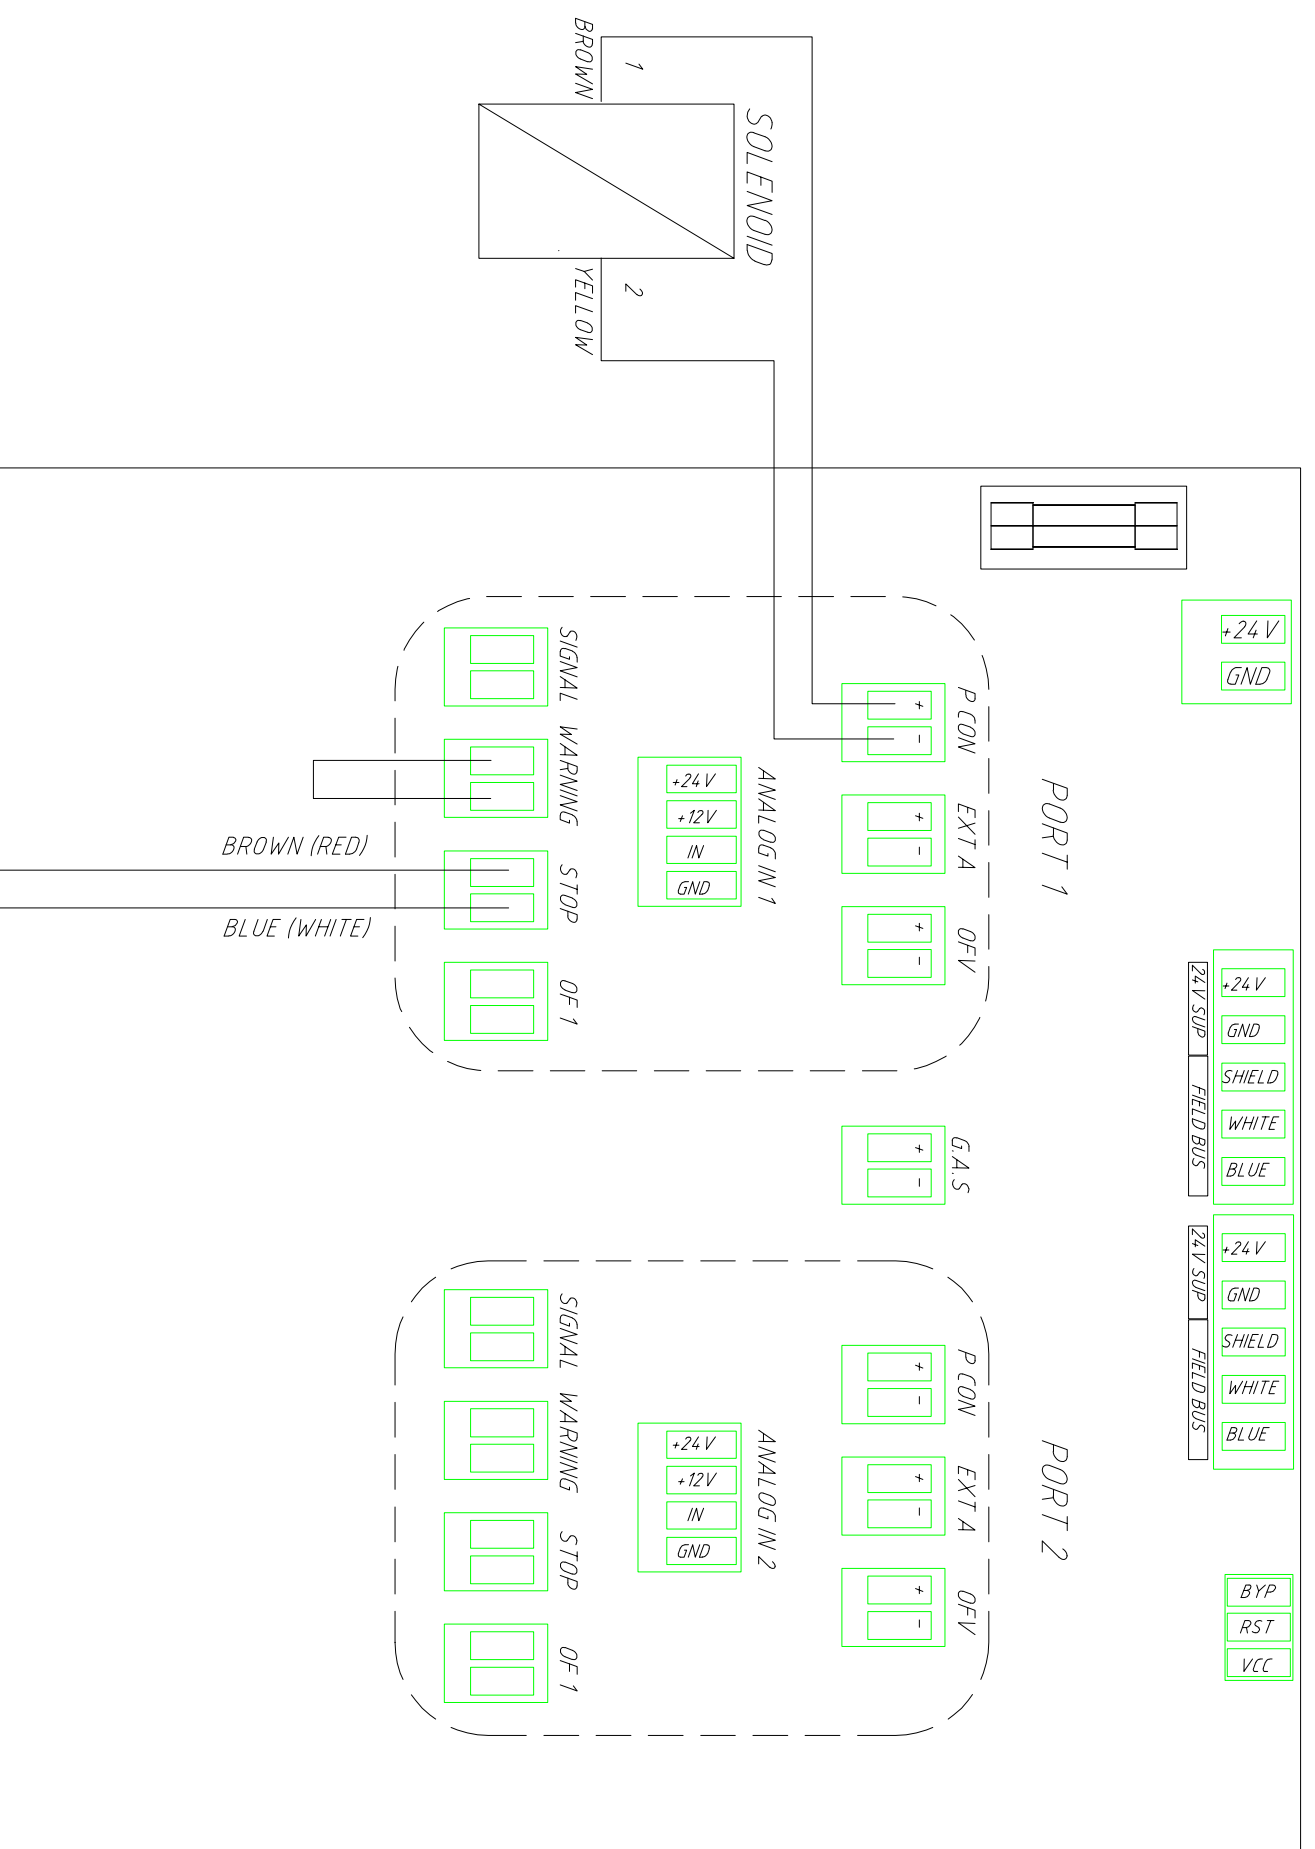

SENSOR 23171,53171 (2330287,53287)

NEXU
FLUID MANAGEMENT SYSTEM

Alentec & Orion AB
Grustagsvägen 4
SE-138 40 Alfta
Tel: +46 (0)8 747 67 00
Fax: +46 (0)8 715 20 74
E-mail: info@alentecc.se
www.alentecc.com

| | | | |
|-------------|---|------------|----------|
| RESPONSIBLE | MIKAEL COMSTEDT | | |
| DRAWN BY | DATE OF ORG | CHECKED BY | DATE |
| MICO | 24.10.04 | KRTY | 24.10.22 |
| SCALE | PROJECT NO | | |
| 1:XXX | SENSOR 23171/23171, 2330287/53287 (1-LEVEL) | | |
| FILE NAME | ELECTRIC INSTALLATION UTANK DWG | | |
| REV | A | | |