


FRESH FLUID. SENSOR 234 17/534 17/35/37
(ANALOGUE SENSOR) AND AIR SOLENOID

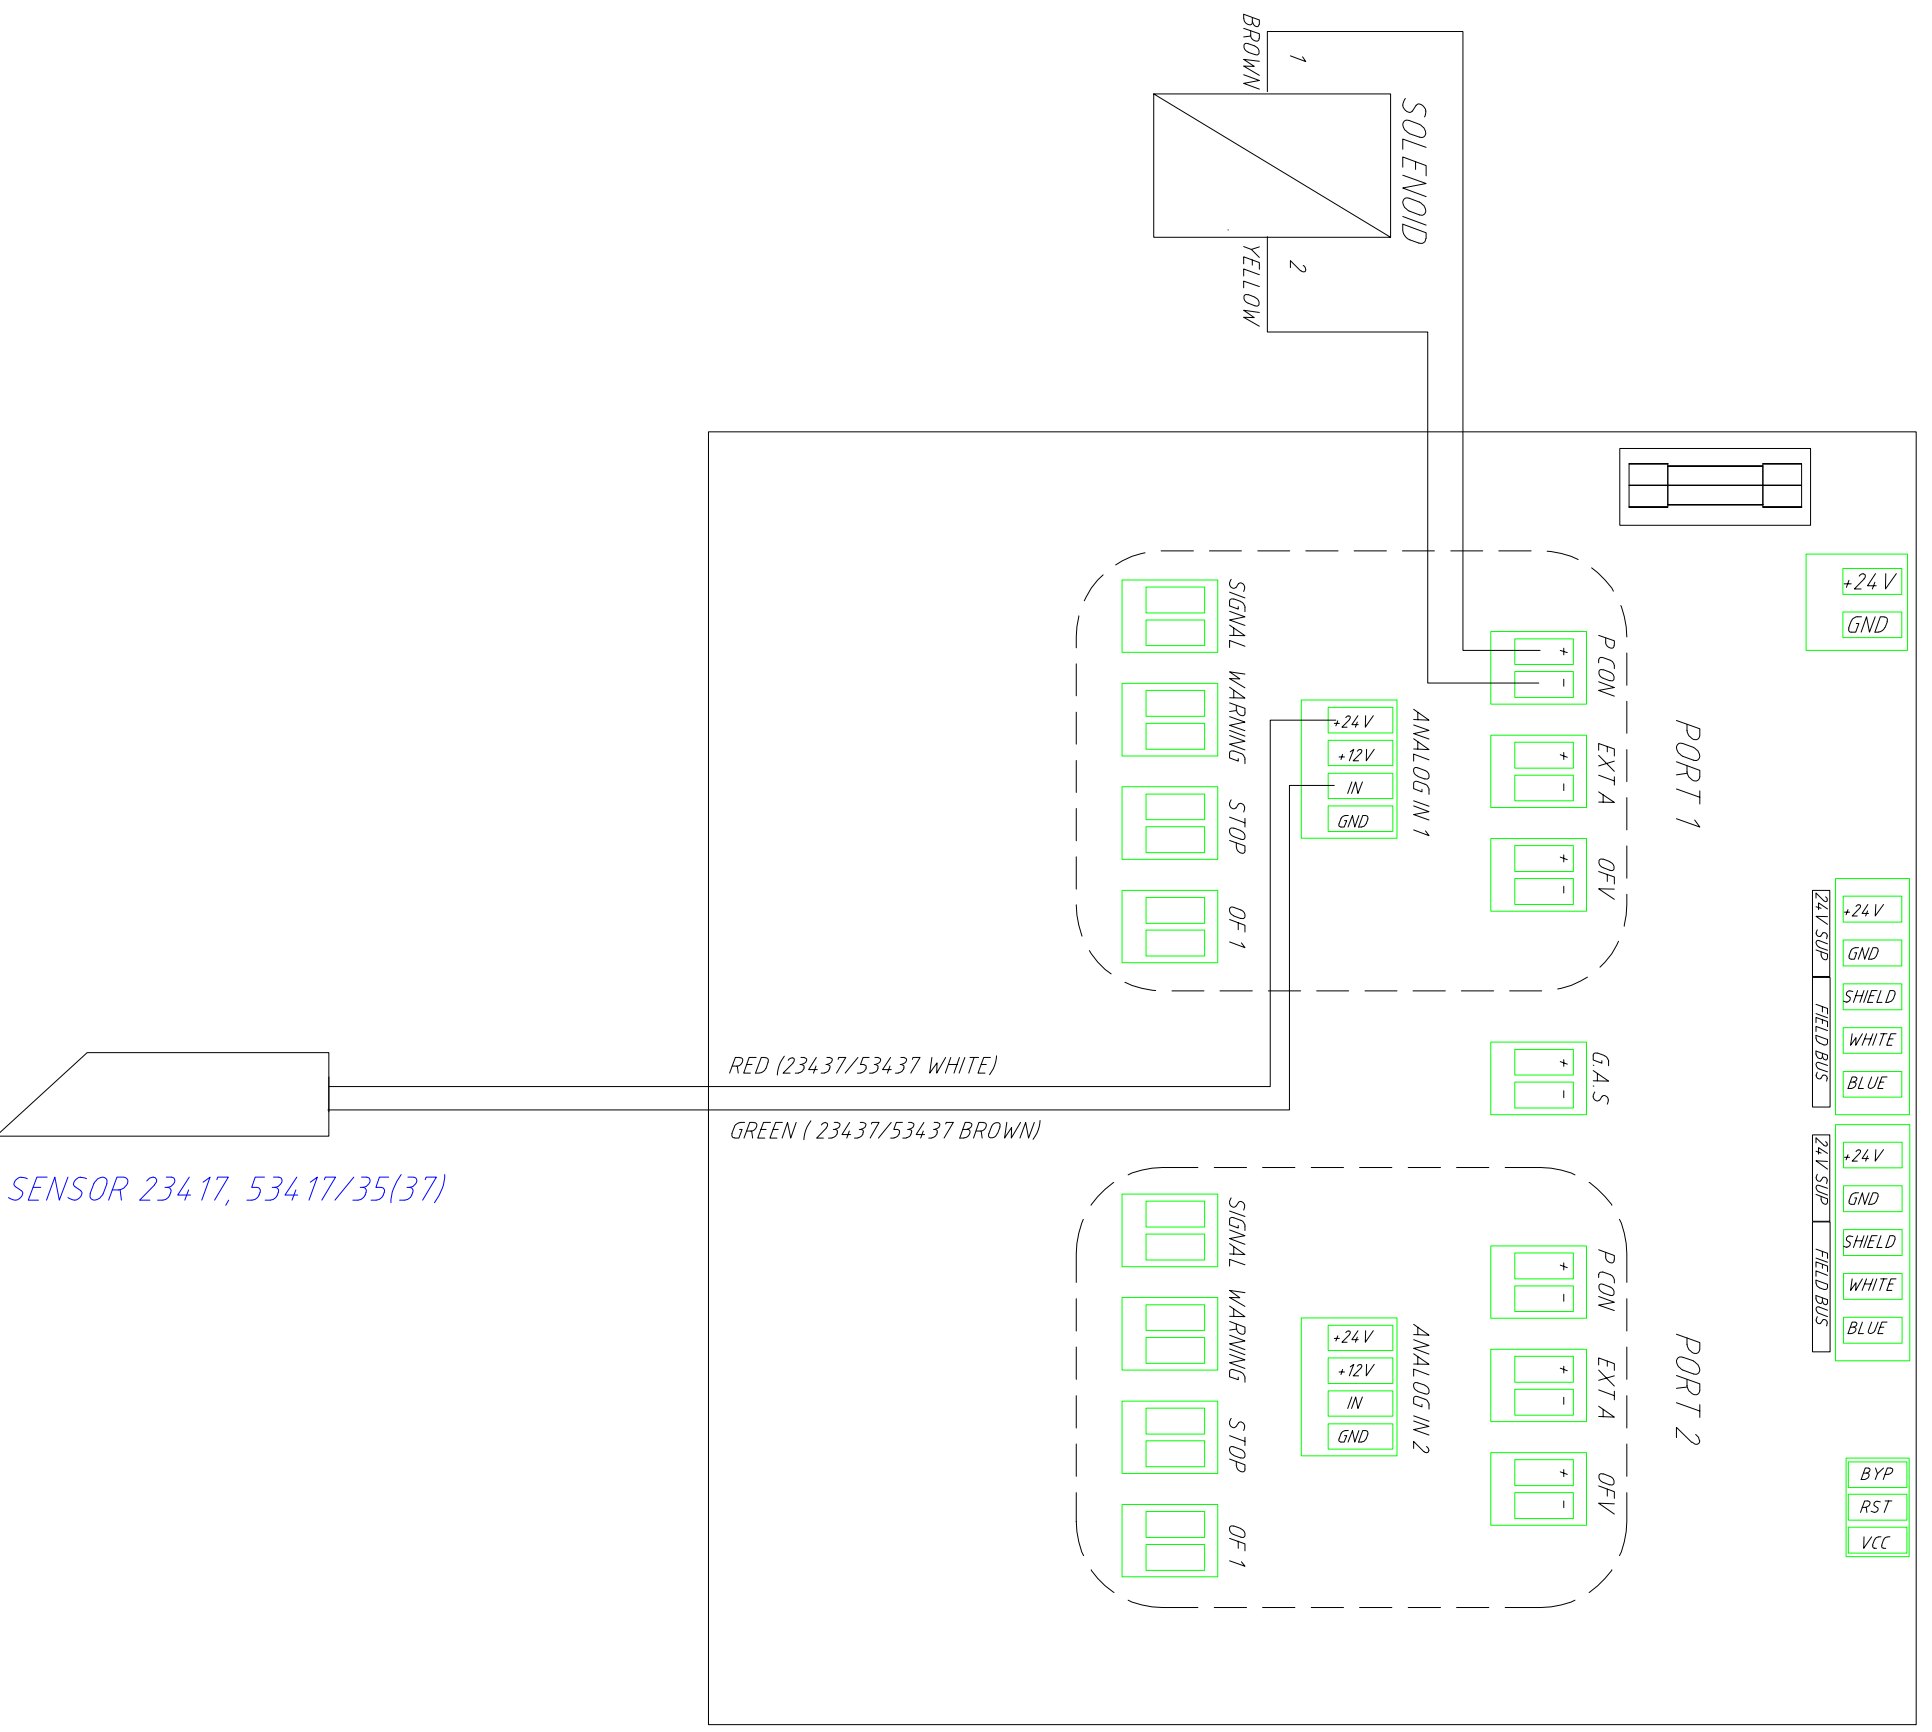

SENSOR 234 17, 534 17/35(37)

This drawing remains the property of Alentec & Orion AB and is not to be copied without our permission nor is it to be shown or handed over to comprehensive firms or any third person

Bl 2021 Utgåva E. (acad)

NEXU
FLUID MANAGEMENT SYSTEM

Alentec & Orion AB
Grustagsvägen 4,
SE-138 40 Alfta

Tel: +46 (0)8 747 67 00
Fax: +46 (0)8 715 20 74
E-mail: info@alentecc.se
www.alentec.com

RESPONSIBLE	MIKAEL COMSTEDT		
DRAWN BY	DATE OF ORG	CHECKED BY	DATE
MICO	24.10.04	KRTY	24.10.22
SCALE	1:1		
TYPE	SENSOR 234 17/534 17/35/37		
FILE NAME	ELECTRIC INSTALLATION UTANK DWG		
REV	A		